


BOROUGH OF BELMAR
Bureau of Fire Protection & Prevention
Office of Fire Marshal

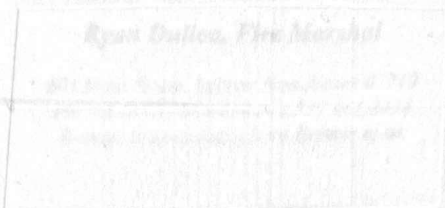

PLACES OF ASSEMBLY PRE-INSPECTION CHECKLIST

EXITS

- Doors and aisles are not obstructed
- Approved panic hardware installed on exit doors.
- No slide bolts, hasps, etc. on doors.
- Illuminated exit signs lit.
- Emergency lighting operable

FIRE EXTINGUISHERS

- Yearly service tag in date. One year cycle
- Fire extinguisher hung up or in approved cabinet and not obstructed.

FIRE PROTECTION EQUIPMENT

- Hood extinguishing system maintained, and six month service and hood cleaning documented.
- Fire detection system tested annually and records kept.
- Sprinkler system tested annually and records kept. _
- 18 inch clearance around sprinkler heads.
- Outside sprinkler connection maintained with proper signage.

ELECTRICAL

- No extension cords used in place or permanent wiring.
- No multi pug adapters in use, other than approved power strips.
- 30 inch clearance in front of circuit breaker box.
- Cover plates on all outlets and switches.

FLAMMABLE, COMBUSTIBLE, COMPRESSED GASSES, LIQUIDS, ETC.

- No propane stored inside any building.
- Patio type heaters prohibited.
- All compressed gas cylinders chained securely to wall.
- Flammable liquids stored properly in approved containers and cabinets.

GENERAL

- 36 inch clearance around heaters.
- Fire lanes marked out and maintained if required.

***Note: This is a list of the most common violations that can be readily identified by the occupant. This is only a guide, and does not include every fire code violation ***

BOROUGH OF BELMAR
Bureau of Fire Protection & Prevention
Office of Fire Marshal

PRE-INSPECTION CHECKLIST

EXITS

- Doors and aisles are not obstructed
- No slide bolts, hasps, etc. on doors.
- Illuminated exit signs lit.
- Emergency lighting operable

FIRE EXTINGUISHERS

- As a minimum one 5 lb. ABC type extinguisher installed
- Yearly service tag in date. One year cycle
- Fire extinguisher hung up or in approved cabinet and not obstructed.

FIRE PROTECTION EQUIPMENT

- Hood extinguishing system maintained, and six month service and hood cleaning documented.
- Fire detection system tested annually and records kept
- Sprinkler system tested annually and records kept
- 18 inch clearance around sprinkler heads
- Outside sprinkler connection maintained with proper signage.

ELECTRICAL

- No extension cords used in place or permanent wiring.
- No multi pug adapters in use, other than approved power strips.
- 30 inch clearance in front of circuit breaker box
- Cover plates on all outlets and switches.

FLAMMABLE, COMBUSTIBLE, COMPRESSED GASSES, LIQUIDS, ETC.

- No propane stored inside any building.
- All compressed gas cylinders chained securely to wall.
- Flammable liquids stored properly in approved containers and cabinets.

GENERAL

- 36 inch clearance around heaters.
- Fire lanes marked out and maintained if required.

*** Note: This is a list of the most common violations that can be readily identified by the occupant. This is only a guide, and does not include every fire code violation ***